

5818 ROUTE 9H & 23 HUDSON, NY 12534

SEPTIC TANKS  
 DRY WELLS  
 D-BOXES  
 CATCH BASINS

**KEELER  
 VAULT  
 CO.**


STEPS  
 CURBING  
 WHEEL STOPS  
 CUSTOM WORK

*PRECAST CONCRETE PRODUCTS*



**518-851-6281**  
**518-851-9134**  
**FAX 518-851-7835**  
**www.keelervault.com**

**MODEL 1000-PG**  
**1000 GALLON TANK USED AS GREASE INTERCEPTOR**  
**3 INLETS 1 OUTLET**

**TOP VIEW**

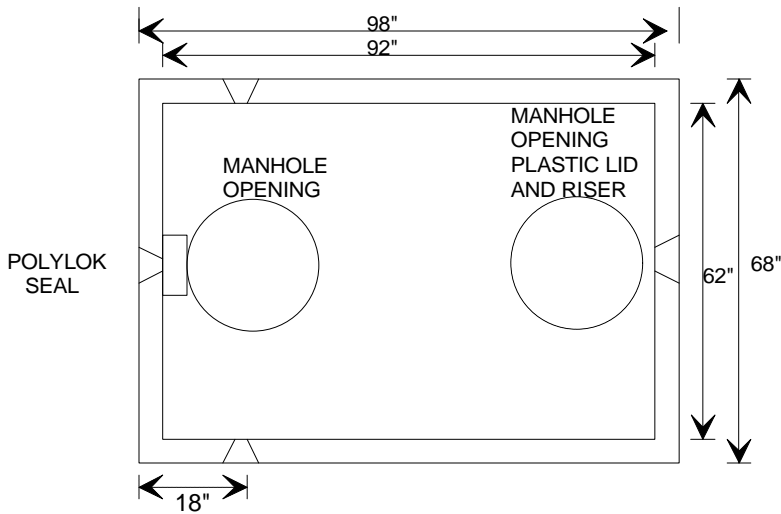

**END VIEW**

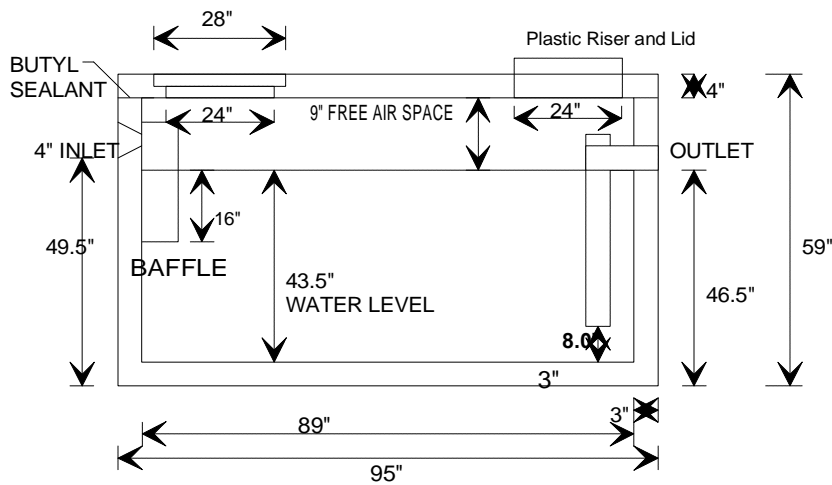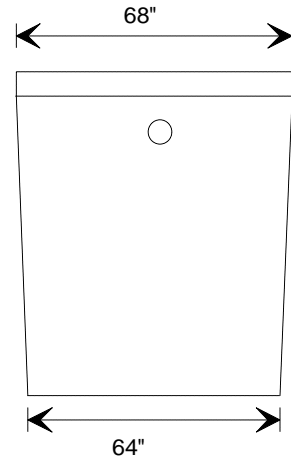

**SIDE VIEW**

- Specifications: Concrete minimum strength-5000 psi at 28 days  
 Air entrainment - minimum 5%  
 Reinforcement- Base: Euclid Tuf Strand SF Fiber(6lbs./yd)  
 #3 Grade 60 deformed rebar  
 Lid: #4 Grade 60 deformed rebar  
 Pipe connections - Polylok seals (patented)  
 Baffles - Plastic Polylok inlet  
 Outlet piping is not supplied

**WEIGHT: 9310 LBS.**

MAXIMUM RECOMMENDED DEPTH OF  
 COVER OVER TANK-3 FEET