

5818 ROUTE 9H & 23 HUDSON, NY 12534

SEPTIC TANKS  
DRY WELLS  
D-BOXES  
CATCH BASINS

**KEELER  
VAULT  
CO.**


STEPS  
CURBING  
WHEEL STOPS  
CUSTOM WORK

*PRECAST CONCRETE PRODUCTS*


**518-851-6281**  
**518-851-9134**  
**FAX 518-851-7835**

**MODEL 1000-P  
STANDARD 1000 GALLON PUMP STATION  
WITH SINGLE PUMP  
3 INLETS 1 OUTLET**


**TOP VIEW**

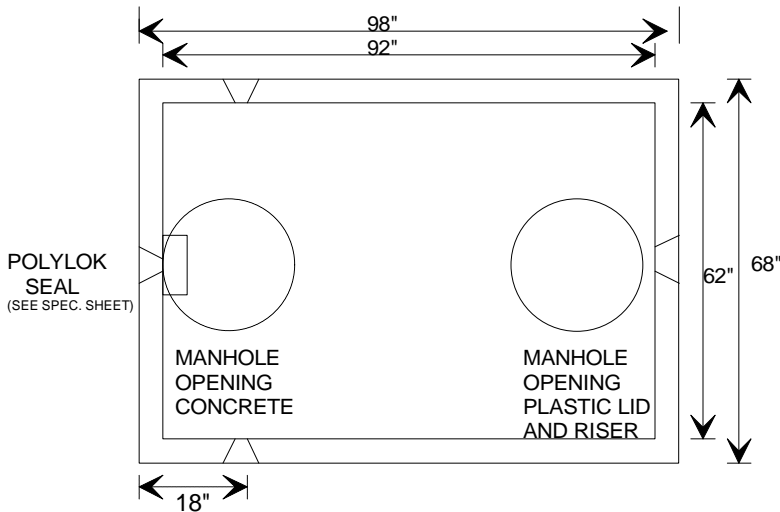

**END VIEW**

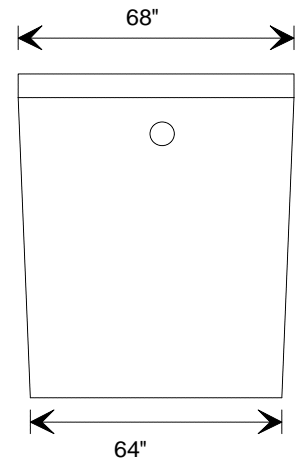

**SIDE VIEW**

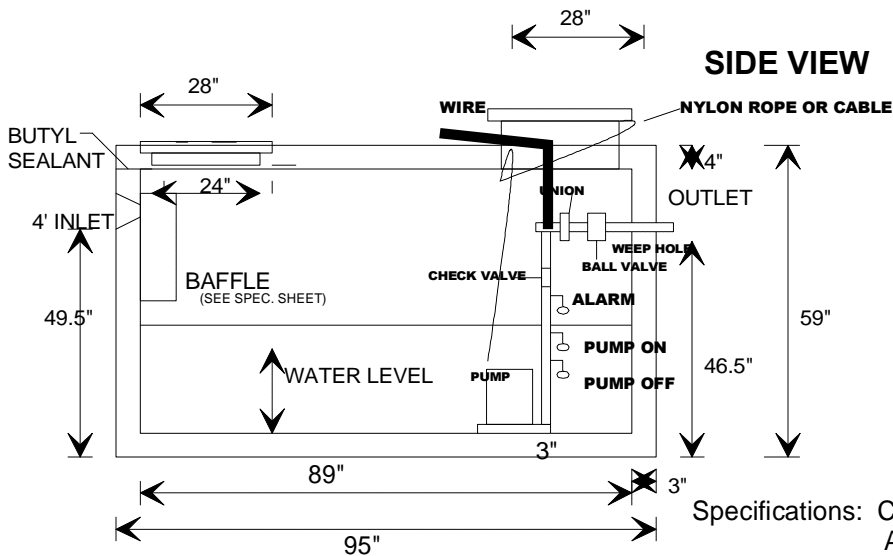

Specifications: Concrete minimum strength-5000 psi at 28 days  
Air entrainment - minimum 5%  
Reinforcement- Base: Euclid Tuf Strand SF Fiber (6lbs./yd), #3 Grade 60 deformed rebar  
Lid: #4 Grade 60 deformed rebar  
Pipe connections - Polylok seals (patented)  
Baffles - Plastic inlet  
Single Pump, Check Valve, Plastic Union, Ball Valve  
Outdoor or Indoor Alarm, 3 float switches  
**Pump size must be known**  
**DRAW DOWN IS 23 GALLONS/INCH**  
**Draw down should not be less than 5" due to float design. If less than 5", control panel should be used.**

**WEIGHT: 9,310 LBS.**

MAXIMUM RECOMMENDED DEPTH OF COVER OVER TANK-3 FEET†