

5818 ROUTE 9H & 23 HUDSON, NY 12534

SEPTIC TANKS
DRY WELLS
D-BOXES
CATCH BASINS

**KEELER
VAULT
CO.**


STEPS
CURBING
WHEEL STOPS
CUSTOM WORK

PRECAST CONCRETE PRODUCTS




518-851-6281
518-851-9134
FAX 518-851-7835
www.keelervault.com

MODEL 1000-HS20C1
H2O-1000 GALLON SEPTIC/PUMP TANK
3 INLETS 1 OUTLET

TOP VIEW

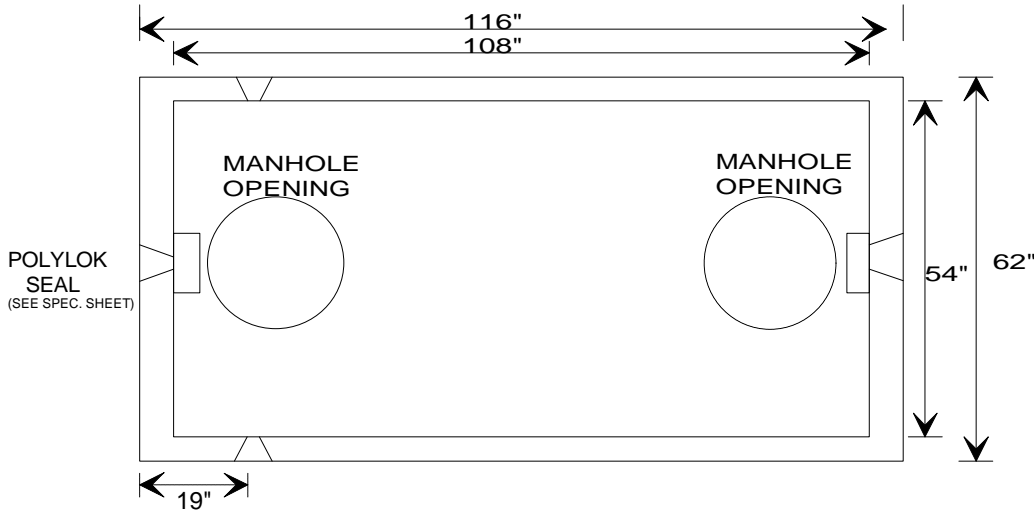

END VIEW

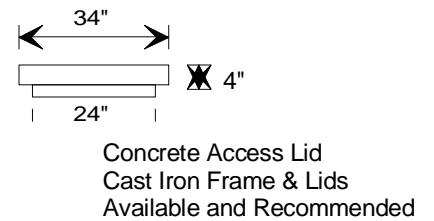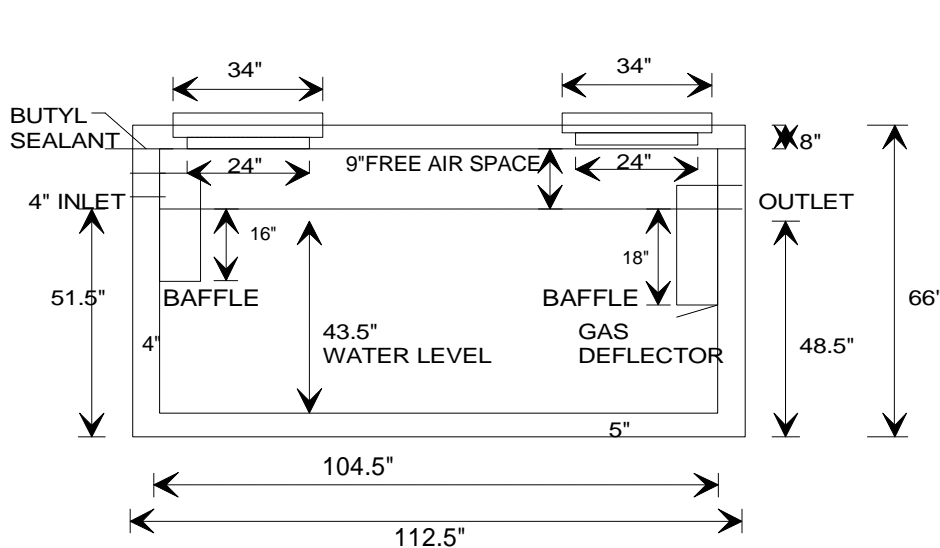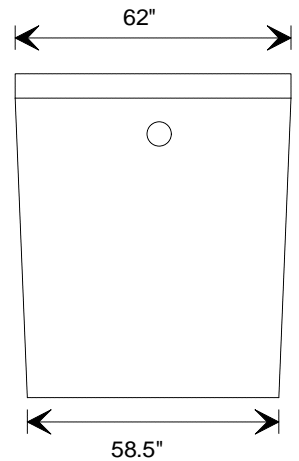

SIDE VIEW

Specifications: Concrete minimum strength-5000 psi at 28 days
Air entrainment - minimum 5%
Reinforcement- Base: #3 Grade 60 deformed rebar
Lid: #4 Grade 60 deformed rebar
Pipe connections - Polylok seals (patented)
Baffles - Plastic Polylok inlet and outlet
w/gas deflector (patented)
CAST IRON FRAME & LIDS ARE RECOMMENDED
Stamped Engineered Plans Available

WEIGHT: 15,100 LBS.

MAXIMUM RECOMMENDED DEPTH OF COVER OVER TANK-3 FEET

SEE REVERSE SIDE FOR REINFORCEMENT POSITIONING