

5818 ROUTE 9H & 23 HUDSON, NY 12534

SEPTIC TANKS
DRY WELLS
D-BOXES
CATCH BASINS

**KEELER
VAULT
CO.**


STEPS
CURBING
WHEEL STOPS
CUSTOM WORK

PRECAST CONCRETE PRODUCTS


518-851-6281
518-851-9134
FAX 518-851-7835

MODEL 1250-P
STANDARD 1250 GALLON PUMP TANK
3 INLETS 1 OUTLET


TOP VIEW

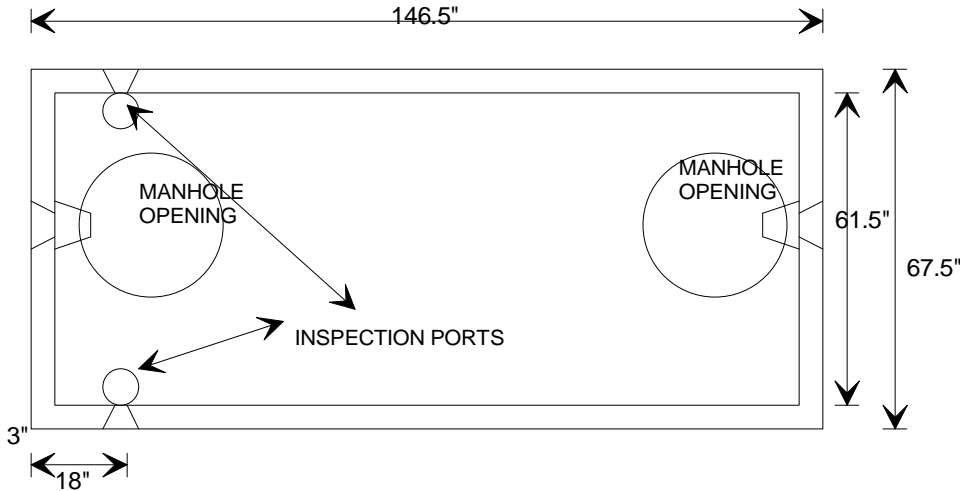

END VIEW

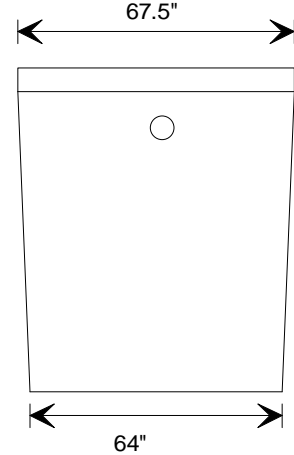

SIDE VIEW

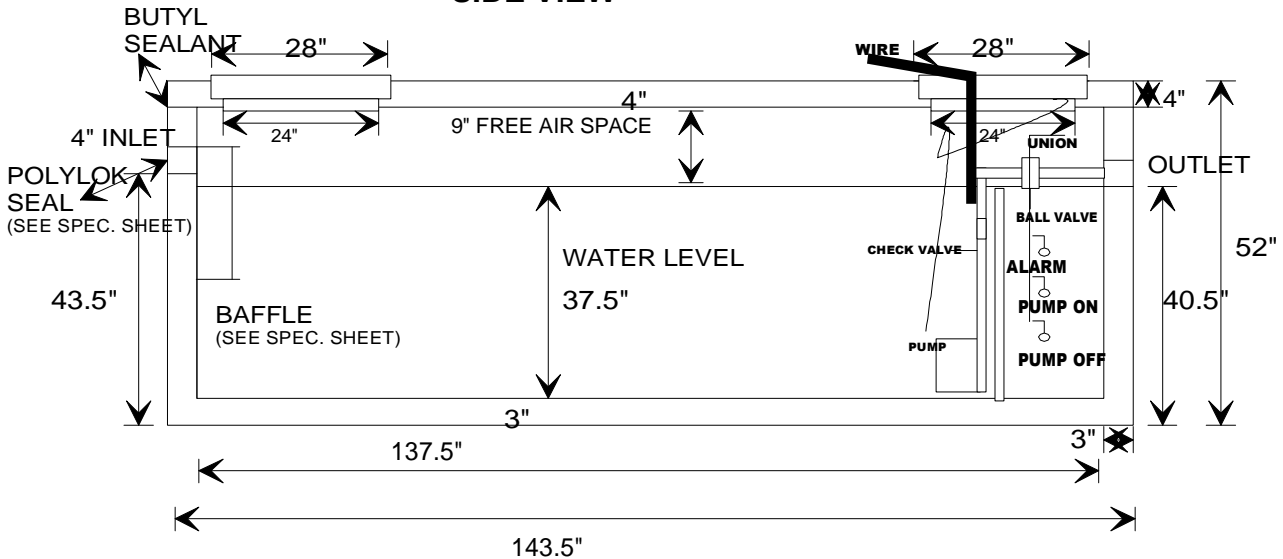

Specifications: Concrete minimum strength-5000 psi at 28 days
Air entrainment - minimum 5%. Reinforcement- Base: Euclid
Tuf Strand SF Fiber (6lbs./yd) #3 Grade 60 deformed rebar
Lid: #4 Grade 60 deformed rebar. Pipe connections -
Polylok seals (patented) Baffles - Plastic inle
Single Pump, Check Valve, Plastic Union, Ball Valve, Outdoor or Indoor
Alarm, 3 float switches, **Pump size must be known**
DRAW DOWN IS 34 GALLONS/INCH
Draw down should not be less than 5" due to float
design. If less than 5", control panel should be
used.

WEIGHT: 12,145 LBS.

MAXIMUM RECOMMENDED DEPTH OF
COVER OVER TANK-3 FEET

SEE REVERSE SIDE FOR REINFORCEMENT POSITIONING