

5818 ROUTE 9H & 23 HUDSON, NY 12534

SEPTIC TANKS  
DRY WELLS  
D-BOXES  
CATCH BASINS



**KEELER  
VAULT  
CO.**

STEPS  
CURBING  
WHEEL STOPS  
CUSTOM WORK

*PRECAST CONCRETE PRODUCTS*

**518-851-6281**  
**518-851-9134**  
**FAX 518-851-7835**

**MODEL JET 1000GPD-S**  
**SYSTEM MEETS N.S.F. STANDARD 40**  
**3 INLETS 1 OUTLET**  
**REQUIRES MINIMUM 1000 GALLON TRASH TANK IN FRONT OF PLANT**

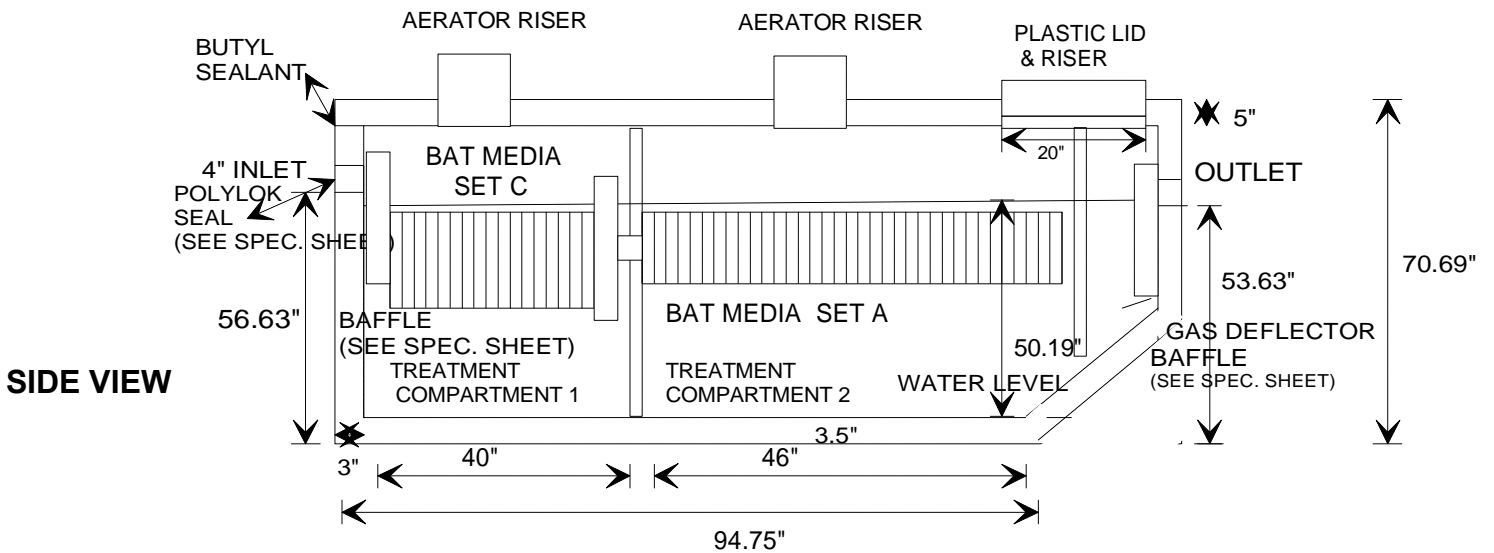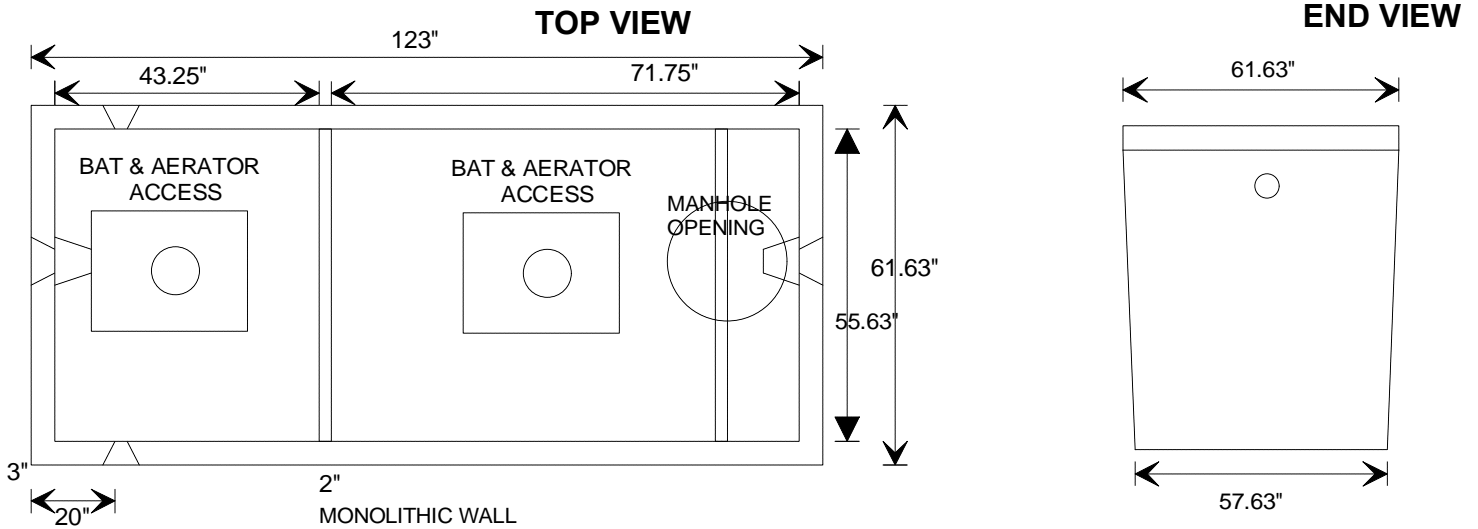

- Specifications:
- Concrete minimum strength-5000 psi at 28 days
  - Air entrainment - minimum 5%
  - Reinforcement- Base: Euclid Tuf Strad SF (6lbs./yd.)  
#3 Grade 60 deformed rebar
  - Lid: #4 Grade 60 deformed rebar
  - Pipe connections - Polylok seals (patented)
  - Baffles - Plastic inlet  
Plastic outlet w/gas deflector (patented)

**WEIGHT: 12,218 LBS.**

MAXIMUM RECOMMENDED DEPTH OF COVER OVER TANK- 3 FEET

SEE REVERSE SIDE FOR REINFORCEMENT POSITIONING